

Input: 0-25 Hz to 0-20 kHz
Output: 0-1 V to 0-10 VDC, ±1 VDC to ±10 VDC, 0-1 mA to 20 mADC

- Precision Frequency to DC Converter
- Plug In Design for Faster Installation
- Full 2000 V Input/Output/Power Isolation
- Input and Output LoopTracker® LEDs
- Functional Test Button
- Built-In Loop Power Supply for Output

Applications

- Monitor and Control Motor or Line Speed
- Convert Speed and Frequency Signals
- Simplify Interfacing of Frequency Sensors

Frequency Input Range

Factory configured, please specify input range
 Frequency: 0-25 Hz to 0-20 kHz
 5 µsec minimum pulse, 100 mV minimum amplitude change

Input Amplitude Range

100 mV to 150 V_{RMS}

Input Impedance

10 kΩ nominal (maximum sensitivity)
 100 kΩ nominal (minimum sensitivity)

Input Sensitivity/Hysteresis

Single turn potentiometer for sensitivity adjustment
 Maximum sensitivity: ±25 mV typical
 Minimum sensitivity: ±2.5 V typical

Input Protection

Normal mode: 200% of input rating
 Common mode: 600 VDC or 600 VACp input to ground
 System voltages must not exceed socket voltage rating

Input Power Supply

18 VDC ±10%, unregulated, 25 mADC, max. ripple, <1.5 V_{P-P}
 May be used to power sensor

LoopTracker

Variable brightness LEDs indicate I/O loop level and status

DC Output Range

Factory configured, please specify output range
 Voltage: 0-1 VDC to 0-10 VDC
 Bipolar voltage: ±1 VDC to ±10 VDC
 Current: 0-2 mADC to 0-20 mADC
 20 V compliance, 1000 Ω at 20 mA

Output Calibration

Multi-turn zero and span potentiometers
 ±15% of adjustment range typical

Output Loop Power Supply

20 VDC nominal, regulated, 25 mADC, max. ripple <10 mV_{RMS}
 Order EXTSUP for an unpowered mA output

Output Test

Button sets output to test level when pressed
 Factory set to approximately 50% of span

Output Ripple and Noise

Less than 10 mV_{RMS}

Linearity

Better than ±0.3% of span

Ambient Temperature Range and Stability

-10°C to +60°C operating ambient
 Better than ±0.02% of span per °C stability

Response Time

70 milliseconds typical

Isolation



2000 V_{RMS} minimum
 Full isolation: power to input, power to output, input to output

Installation Environment

IP 40, requires installation in panel or enclosure
 Use with API 008 or API 008 FS socket
 Socket mounts to 35 mm DIN rail or can be surface mounted
 UL 508C pollution degree 2 environments or better

Power

Standard: 115 VAC ±10%, 50/60 Hz, 2.5 W max.
 A230 option: 230 VAC ±10%, 50/60 Hz, 2.5 W max.
 P option: 85-265 VAC 50/60 Hz, 60-300 VDC 2.5 W typ.
 D option: 9-30 VDC, 2.5 W typical

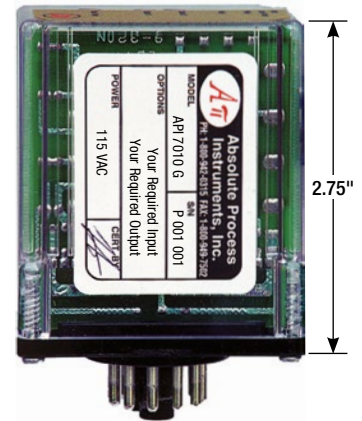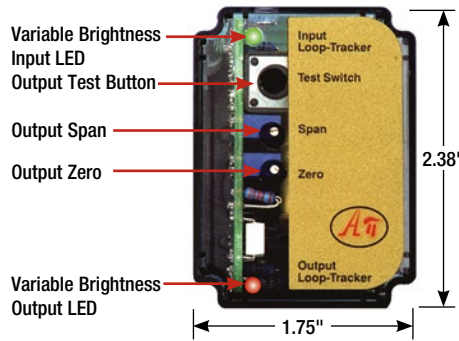

Free Factory I/O Setup!

Hot Swappable Plug-In Design



UL US
 E145968
 115 VAC, 230 VAC models

Description

The API 7010 G accepts a frequency input and provides an optically isolated DC voltage or current analog output that is linearly proportional to the input.

The full 3-way (input, output, power) isolation between input and output makes this module useful for ground loop elimination, common mode signal rejection or noise pickup reduction.

Also standard on the API 7010 G is an 18 VDC input excitation supply. If needed, this supply can be used to power a passive sensor, eliminating the need for an additional external power supply.

Common applications include frequency to DC conversions from frequency output type devices such as rotary encoders, magnetic pick-ups, variable speed drives and flow meters.

The API 7010 G can also be used to convert a PLC pulse rate output to a proportional analog signal.

Output Loop Power Supply

Standard on the API 7010 G is an 20 VDC loop excitation supply. This supply can be used to power passive input devices, often eliminating the need for an additional external power supply. Order option EXTSUP if an unpowered or passive output is needed.



LoopTracker

API exclusive features include two LoopTracker LEDs (green for input, red for output) that vary in intensity with changes in the process input and output signals. These provide a quick visual picture of your process loop at all times and can greatly aid in saving time during initial startup and/or troubleshooting.

Output Test

An API exclusive feature includes the test button to provide a fixed output (independent of the input) when held depressed. The test output level is potentiometer adjustable 100% of the output span.

The output test button greatly aids in saving time during initial startup and/or troubleshooting.

Model	Input	Output	Power
API 7010 G	Factory ranged Specify frequency range 0-25 Hz to 0-20 kHz	Factory configured specify output range in volts or mA	115 VAC 
API 7010 G A230			230 VAC 
API 7010 G P			85-265 VAC or 60-300 VDC
API 7010 G D			9-30 VDC

Options—add to end of model number

- EXTSUP** Open collector output when a “sinking” output is required for an external loop supply
U Conformal coating for moisture resistance

Accessories—order as separate line item

- API 008** 8-pin socket
API 008 FS 8-pin finger-safe socket
API CLP1 Module hold-down spring for high vibration or mobile applications



Precautions

WARNING! All wiring must be performed by a qualified electrician or instrumentation engineer. See diagram for terminal designations and wiring examples. Consult factory for assistance.

WARNING! Avoid shock hazards! Turn signal input, output, and power off before connecting or disconnecting wiring, or removing or installing module.

Précautions

ATTENTION! Tout le câblage doit être effectué par un électricien ou ingénieur en instrumentation qualifié. Voir le diagramme pour désignations des bornes et des exemples de câblage. Consulter l'usine pour assistance.

ATTENTION! Éviter les risques de choc! Fermez le signal d'entrée, le signal de sortie et l'alimentation électrique avant de connecter ou de déconnecter le câblage, ou de retirer ou d'installer le module.

API maintains a constant effort to upgrade and improve its products. Specifications are subject to change without notice. See api-usa.com for latest product information. Consult factory for your specific requirements.



WARNING: This product can expose you to chemicals including lead and nickel, which are known to the State of California to cause cancer or birth defects or other reproductive harm. For more information go to www.P65Warnings.ca.gov

Socket and Mounting

The module installation requires a protective panel or enclosure. Use API 008 or finger-safe API 008 FS socket.

The socket clips to a standard 35 mm DIN rail or can be attached to a flat surface using the two mounting holes.

Output Wiring

The output range is pre-configured at the factory as specified on your order. Polarity must be observed when connecting the signal output to the load. See the table below and the wiring diagrams at right.

If ordered with a mA output, the API 7010 G provides power to drive the current loop.

If ordered with a mA output and the EXTSUP option, your current loop must provide power to the API 7010 G output

Type of Device for Output	Output -	Output +
Measuring/recording device accepts a voltage input.	8 (-)	7 (+)
Measuring/recording device accepts a mA (current) input and the input is unpowered or passive. API module provides the loop power.	8 (-)	7 (+20 V)
EXTSUP option. Measuring or recording device accepts a mA (current) input and provides power to the current loop.	8 (-)	7 (+)

Input Wiring

The input range is pre-configured at the factory as specified on your order. No input calibration is necessary. The API 7010 G is compatible with most types of sensors as long as the waveform produces a minimum 100 mV amplitude change and a minimum 5 microsecond pulse width.

An 18 VDC supply is available at terminal 4 to power the sensor if required. Always refer to the sensor manufacturer's data sheet to determine supply voltage compatibility, proper wiring, and if a load or bleed resistor is required. Polarity must be observed.

Sensor Type	Signal +	Sensor Power	Signal Com.
2 wire or Namur with external power	5	4	n/a
2 wire self generating (VR)	5	n/a	6
3 wire PNP current sourcing output	5	4	6
3 wire NPN current sinking output	5	4	6

Sensor Load

The signal input of the API 7010 G is capacitively coupled to prevent any DC in the input. Some sensors, typically those without an internal load resistor, require a resistive load in order to function.

The resistor value may be specified by the sensor manufacturer as the "minimum resistive load" or calculated from the sensor manufacturer's specified "load current range".

The 18 VDC power supply is capable of providing 25 mA. A load current range of 3 mA to 25 mA would typically use a 6 kΩ to 720 Ω resistor.

NPN sensors may require an external resistor across sensor signal and sensor power. See sensor manufacturer's specifications.

PNP sensors may require an external resistor across sensor signal and sensor ground. See sensor manufacturer's specifications.

Module Power


Check model/serial number label for module operating voltage to make sure it matches available power.

When using DC power, polarity must be observed. See wiring diagram.

Three wire NPN

Typical wire colors


- 5 Signal, Black or White
- 4 Power (+18 VDC) Brown or Red
- 6 Common (-), Blue or Black



Three wire PNP


Typical wire colors

- 5 Signal, Black or White
- 4 Power (+18 VDC) Brown or Red
- 6 Common (-), Blue or Black




Two wire powered

- 5 Signal
 - 4 Power (+18 VDC)
- Some sensors may require a bleed resistor to common.



Two wire self-generating


- 5 Signal (+)
- 6 Common (-)

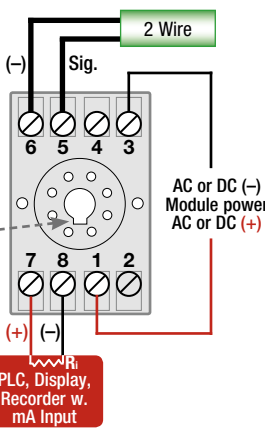


Socket top view

Key down when panel mounting


Sourcing mA output 20 V loop power

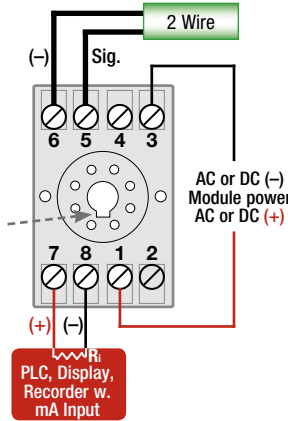


Voltage output



EXTSUP Option Current Sinking mA Output



EXTSUP Option Current Sinking mA Output



Output Calibration

The output range is pre-configured at the factory as specified on your order. Top-mounted Zero and Span potentiometers are used to calibrate the output to compensate for load and lead variations.

1. Apply power to the module and allow a minimum 20 minute warm up time. An accurate frequency calibration source such as a signal generator may be required for calibration.
2. Provide an input to the module equal to the minimum input required for the application. In the most cases the minimum input signal will be 0 Hz.
3. Using an accurate measurement device for the output, adjust the Zero potentiometer for the exact minimum output desired. The Zero control should only be adjusted when the input signal is at its minimum. This will produce the corresponding minimum output signal. For example: 4 mA for a 4-20 mA output or -10 V for a ±10V output.
4. Set the frequency to the maximum input required for the application. This is generally done using a signal generator.
5. Using an accurate measurement device for the output, adjust the Span pot for the exact maximum output desired. The Span control should only be adjusted when the input signal is at its maximum. This will produce the corresponding maximum output signal. Example: for 4-20 mA output signal, the Span control will provide adjustment for the 20 mA or high end of the signal.
6. Repeat adjustments for maximum accuracy.

Sensitivity Adjustment

This multi-turn potentiometer provides an adjustable threshold level that the incoming signal must overcome before an output can be produced.

This is used to limit noise and minimize false input signals that may cause erroneous readings.

When fully clockwise (maximum sensitivity), the input threshold is typically ±25 mV.

In the fully counterclockwise position (minimum sensitivity), the input threshold is typically ±2.5 volts.

Output Test Function

When the Test button is depressed it will drive the output with a known good signal that can be used as a diagnostic aid during initial start-up or troubleshooting. When released, the output will return to normal.

The Test Cal. value is factory set to approximately 50% output.

Operation

The API 7010 G accepts a frequency input and provides an optically isolated DC voltage or current output that is linearly related to the input. The frequency input can be virtually any type of signal (sine wave, sawtooth, square wave, etc.) as long as there is a sufficient change in amplitude (greater than 100 mV).

The frequency input to the API 7010 G is capacitively coupled (to remove any DC component at the input) to a comparator whose threshold is determined by the setting of the sensitivity control. The output from the comparator passes through an optocoupler to the output stage.

The green LoopTracker® input LED provides a visual indication that a signal is being sensed by the input circuitry of the module. The LED illuminates when the input is sufficiently large to trigger the input comparator depending on the input sensitivity adjustment.

It also indicates the input signal range by changing in intensity as the frequency changes from minimum to maximum. If the LED fails to illuminate, or change in intensity as the frequency changes, it may indicate a problem with module power, or signal input wiring.

Note that it may be difficult to see the LEDs under bright lighting conditions.

The red LoopTracker output LED provides a visual indication that the output signal is functioning. It becomes brighter as the input and the corresponding output change from minimum to maximum.

For current outputs, the red LED will only light if the output loop current path is complete. For either current or voltage outputs, failure to illuminate or a failure to change in intensity as the process changes may indicate a problem with the module power or signal output wiring.